

Thrust Area 4: Solar (Thermal)

Design, Construction and Operation of CSP Solar Thermal Power Plants in Florida

PI: D. Yogi Goswami **Co-PIs:** Elias Stefanakos, Muhammad M. Rahman, Sunol Aydin, Robert Reedy

Students: Gokmen Demirkaya (Ph.D.); Ricardo Vasquez Padilla (Ph.D.); Huijuan Chen (Ph.D.); Jamie Trahan (Ph.D.)

Description:

Florida utilities are mandated to achieve 20% renewable energy contribution to their generation mix by 2020. While technologically feasible with solar energy, the capital costs are high – presently, capital costs range from \$6,000-\$7,000/kW for PV and \$3,500-\$4,000/kW for concentrating solar thermal power. This project targets the development of solar thermal power technology for bulk power and distributed generation, which will diversify energy resources in Florida and reduce greenhouse emissions by utilizing renewable sources. Also, there will be economic impacts with the establishment of new power industry in Florida, which will help the electrical utilities of the state to meet the renewable portfolio standards. The project has three main tasks; the first one is to develop design methodologies and standards for the proven solar thermal power technologies in combination with bio or fossil fuels based on Florida conditions and resources. Secondly, the project aims to set up demonstration and test facilities for these technologies for optimization for Florida conditions, and the final task is to develop and commercialize innovative technologies based on new thermodynamic cycles.

Budget: \$882,000

Universities: USF, UF, UCF

Progress Summary

Research Objectives for Current Reporting Period: The main research objectives for the current reporting period include the development of a test facility and pilot demonstration systems based on parabolic trough technology.

Progress Made Toward Objectives during Reporting Period

Daily integration (DI) approach was used to obtain the average direct normal solar radiation for the location of the pilot demonstration solar plant (USF, Tampa, FL). The direct normal solar radiation obtained for Tampa is shown in Fig. 1. The annual average for this location is 4.6 kWh/m²-day. These solar radiation values and the solar shading analysis for solar collector rows were used for the solar field calculation. The solar field layout proposed for 50 kW_e is shown in Fig. 2. The Soponova 4.0 (Sopogy Inc.) parabolic trough collectors will be used in the solar field for providing 430 W/m² of thermal energy after losses. The solar field is being designed to work in conjunction with a thermal energy storage system which will use phase change material (PCM) as a storage material.


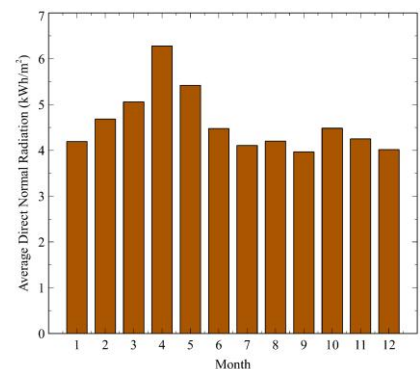


Fig. 1: Direct Normal Radiation for Tampa, FL

The remaining thermal energy will be provided by a natural gas boiler, which will work in series with the solar field and supply thermal energy to the power block when the solar energy is not available.

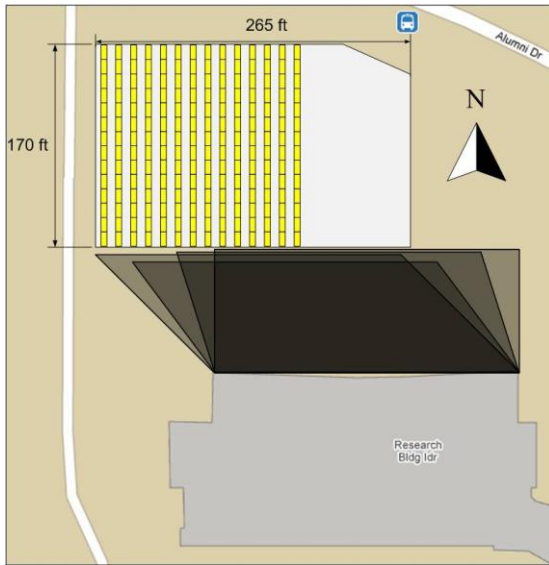

The power block that will convert the thermal energy to electricity is based on Organic Rankine Cycle. This power block will have a nominal capacity of 120 kW_e. A preliminary study on condensation methods for solar thermal plants is also conducted and more research will be devoted to the development of cost effective dry cooling technology.

Research activities for the next reporting period will focus on the modeling of heat transfer losses through the solar receiver and field piping, pressure drops and pumping requirement and thermal energy storage system design.

Fig 2: Proposed Solar Field Layout

2011 Annual Progress Report

Task 1: Development of simulation and design methodology for parabolic trough and parabolic dish

The objective of the task one is to develop a simulation and design methodology for the parabolic trough and parabolic dish based technologies for Florida conditions. Solar radiation, solar collector and thermal storage topics are the subtasks, and following progresses have been made during the period.

Parabolic trough solar systems are currently one of the most mature and prominent applications of

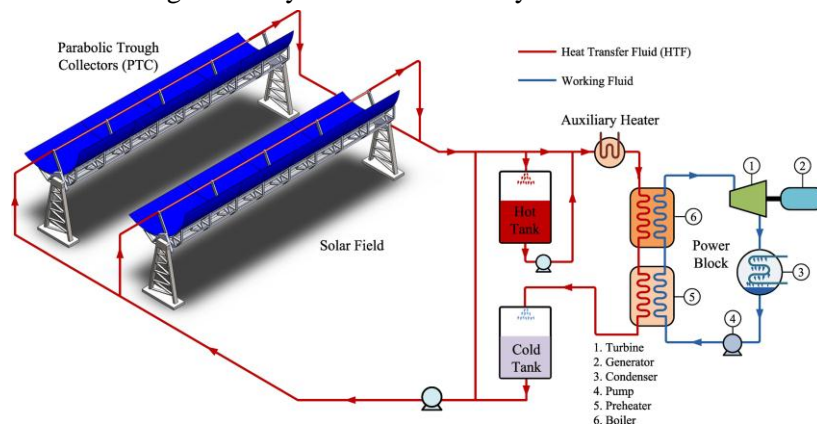


Fig. 3: Parabolic Trough Power Plant

solar energy for production of electricity. Compared to conventional power plants, parabolic trough solar power plants produce significantly lower levels of emissions and carbon dioxide. Thermal simulations and cost analysis of the system are used to evaluate the economic feasibility. Complex models and components are integrated

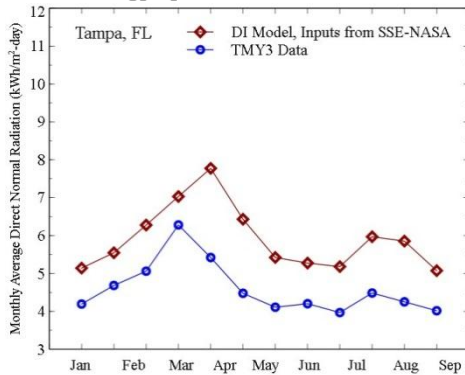


Fig. 4: Comparison of Two Models

to emulate real operating conditions, such as: Solar Radiation Model, Solar Thermal Collector, Thermal Energy Storage, Solar Field Piping, Power Block, Cost Analysis, and Integration of all Systems. This progress report presents a preliminary design method to calculate solar radiation data and thermal collector efficiency which are used to determine the size and the cost of solar field.

An hourly solar radiation model is necessary to calculate the energy input that come from the sun, since the solar collector performance changes during the whole day. The inputs for the hourly solar radiation model are the long term average values of total horizontal and diffuse radiation, which can be obtained by ground or satellite measurements. Satellite data provide information about solar radiation and meteorological conditions in locations where ground measurement data are not available. Gueymard developed a Daily integration approach model to predict the monthly-average hourly global irradiation by using a large dataset of 135 stations with diverse geographic locations (82.58N to 67.68S) and climates. The results showed that the daily integration model is most accurate than previous hourly models.

The second part of this report is about the numerical heat transfer model. The receiver consists of an absorber surrounded by a glass envelope. The absorber is typically stainless steel tube with a selective absorber surface. The glass envelope is an antireflective evacuated glass tube which protects the absorber from degradation and reduces heat losses. The Solar receiver uses conventional glass to metal seals and bellows to achieve the necessary vacuum enclosure and for thermal expansion.

The heat transfer model is based on an energy balance between the heat transfer fluid and the surroundings (atmosphere and sky). A comprehensive radiation model between the absorber and the envelope is included in this study. The results showed that the new model has lower RMSE than the NREL Model (0.985% and 1.382% respectively). The numerical heat transfer model integrated with the solar radiation model can be used for evaluating the performance of solar collectors for any location.

Task 2: Development of a test facility and pilot demonstration

The second task targets the development of a test facility and pilot demonstration systems based on parabolic trough and dish technologies. The experimental combined power and cooling setup will be used as a preliminary study of the demonstration system that will be developed.

PERFORMANCE ANALYSIS OF A RANKINE-GOSWAMI COMBINED CYCLE

Improving the efficiency of thermodynamic cycles plays a fundamental role for the development of solar power plants. These plants work normally with Rankine cycles which present some disadvantages due to the thermodynamic behavior of steam at low pressures. These disadvantages can be reduced by introducing alternatives such as combined cycles which combine the best features of each cycle. In the present study a combined Rankine-Goswami cycle is proposed and a thermodynamic analysis is conducted. The Goswami cycle, used as a bottoming cycle, uses ammonia-water mixture as the working fluid and produces power and refrigeration while power is the primary goal. Figure 5 shows a schematic of the Rankine-Goswami cycle.

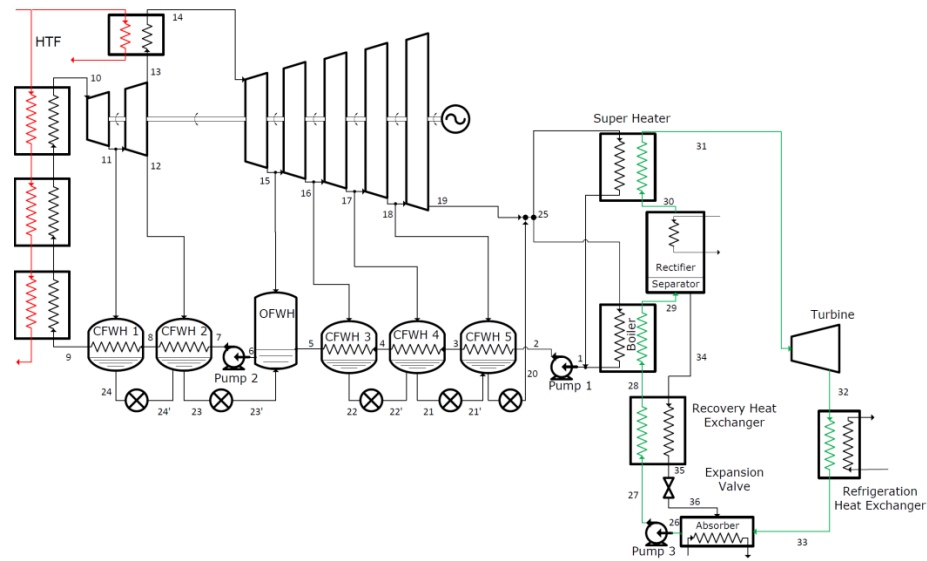


Fig.5

The detailed explanation about the parameters that were used for simulation is given in the paper. Different cases were also considered for parametric studies which are shown below.

Case	Rectifier	Superheater	Controlled Parameter
R	Yes	No	$x_{rectifier} = 0.995$ $T_{superheater} = T_{rectifier}$
R+S	Yes	Yes	$x_{rectifier} = 0.98$ $T_{superheater} = T_{boiler}$
B (Base)	No	No	Saturated vapor condition at the boiler exit

The thermodynamic properties of water and steam were implemented in Python 2.6 by using the international-standard IAPWS-IF97 steam tables. For the Goswami cycle, the properties of ammonia water were obtained from a Gibbs free energy formulation given by Xu and Goswami. In this study the amount of the electric work obtained from the topping cycle was held constant at 50 MWe while for the bottoming cycle the turbine work was considered as an output parameter. Figure 6 shows the effect of the high pressure side on the rectifier temperature and absorber concentration, In this case, the ammonia concentration range was selected such as the absorber was kept at least under atmospheric pressure.

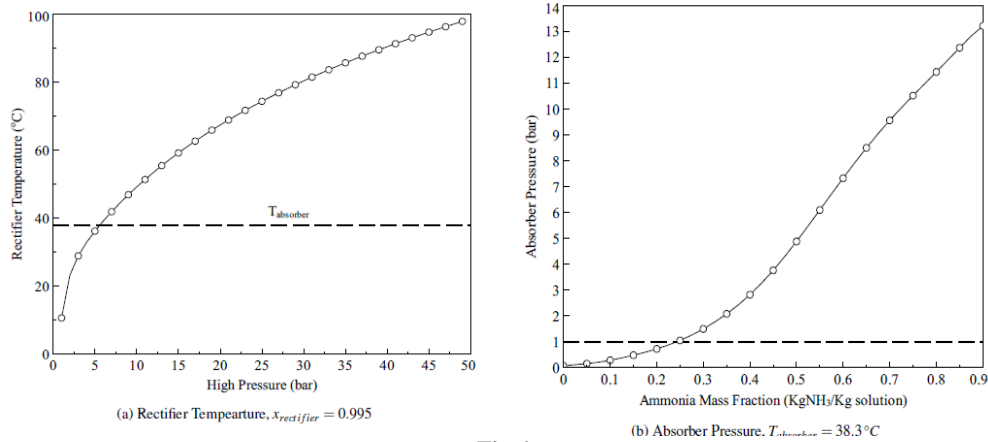


Fig 6

Figure 7 shows the effect of the condenser pressure on the Goswami bottoming cycle exit quality for different cases and ammonia mass fraction. Moreover, Figure 8 shows the effect of the variations of the net -work with the condenser pressure for ammonia mass concentration of 0.3, in all the studied cases.

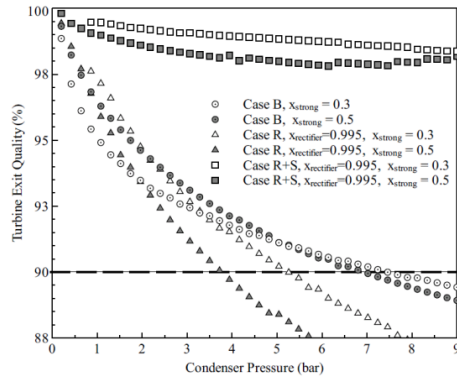


Fig.7

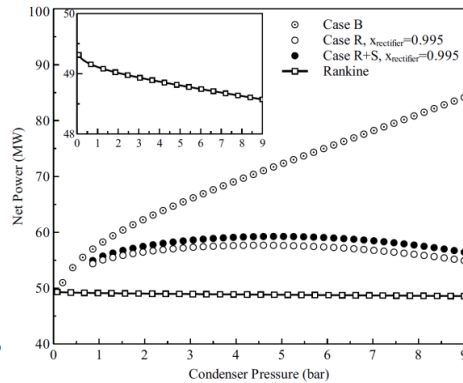


Fig. 8

The effect of condenser pressure on the effective First Law efficiency is also illustrated in Figure 9 while the cooling capacity of the Goswami bottoming cycle is presented in Figure 10. The effective exergy efficiency in the cycle as a function of the condenser pressure and ammonia mass fraction is also presented in Fig.11.

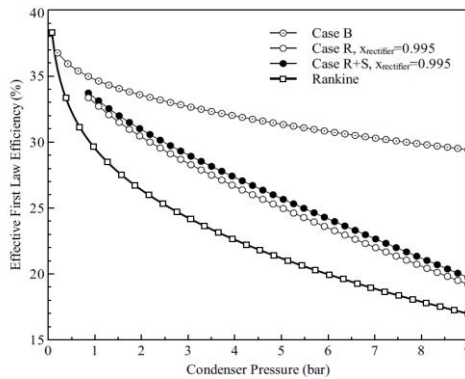


Fig. 9

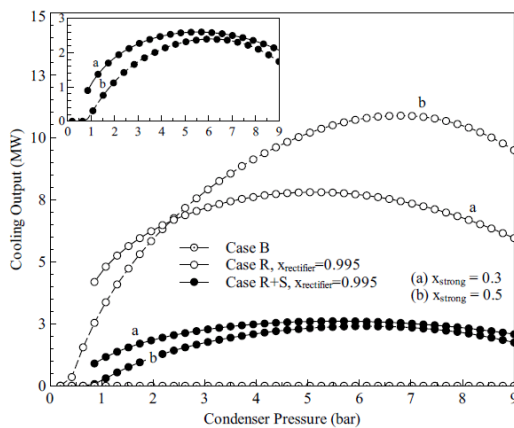


Fig. 10

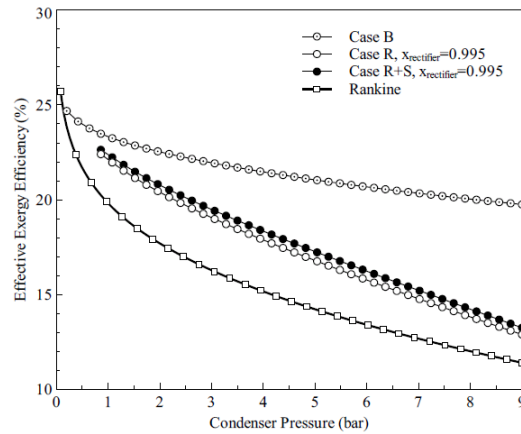


Fig. 11

Task 3. Installation and Operation of 50kWe Solar Power Plant

Sopogy Inc. Honolulu Hawaii is the main contractor for installation and operation of 50kWe Solar Power Plant at USF. SunQuest Energy at Clearwater FL is the sub-contractor of Sopogy. They are currently in final stage for preparing the complete engineering drawing of the Solar Power system in order to get the permit for the construction of solar power plant. It is expected that by the mid November permits should be in place so that Sopogy will be able to ship the material to USF. We are hoping that Sopogy will be able to start the construction of power plant sometime in the month of December 2011. Power block for generating electricity will be supplied by GulfCoast Green Energy. Power block is a Green Machine Elite 4000 manufactured by Electratherm. This machine will produce about 50kWh electricity from the thermal energy produces by solar field that will have 199 Sponova 4.0 parabolic concentrators from Sopogy Inc.

Task 4: Thermal Energy Storage

We are currently working on the development of low cost thermal energy storage (TES) systems for Concentrating Solar Power (CSP). The objective is to research and develop a thermal energy storage system (operating range 300⁰C – 450⁰C) based on encapsulated phase change materials (PCM). The system will be able to meet the utility-scale base-load concentrated solar power plant requirements at much lower system costs compared to the existing TES concepts. This project is developing a TES system concept that will allow for an increase of the capacity factor of the present CSP technologies to 75% or greater and reduce the cost to less than \$10/kWh_t as compared to the present cost of about \$40/kWh_t.

We have successfully prepared porous pellets of phase change materials that will allow for the volumetric expansion during PCM melting and hence impose less stress on the encapsulating material. We have developed the encapsulation techniques and selected the low cost encapsulating materials that will be used to encapsulate the PCM. Currently we are optimizing the process for encapsulating the PCM so that it can undergo at-least one thousand charge and discharge cycles without any deterioration of the encapsulation. We are also working on the development of numerical model that will help to design the thermal energy storage systems.